


Room Utilization Charts – Winter 2013 Term


Frost Campus

Computer Labs - Frost Main Campus

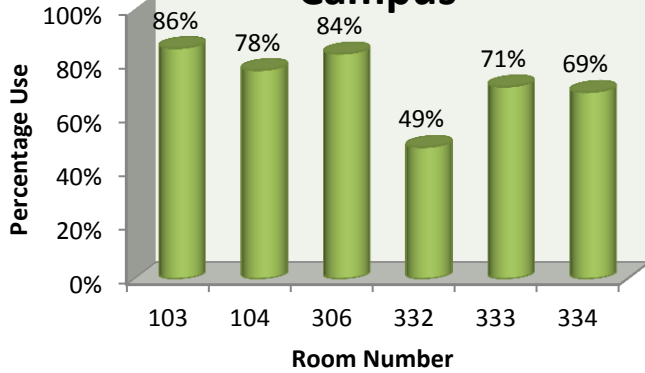


Avg Use=73%

Lecture Theatres - Frost Campus

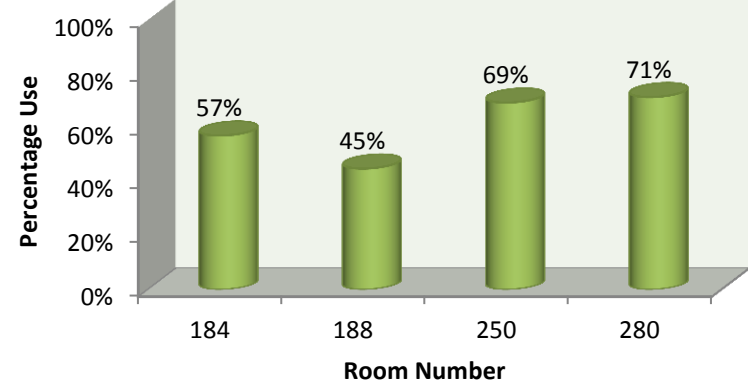

Avg Use=61%

Lab Rooms - Frost Outer Buildings

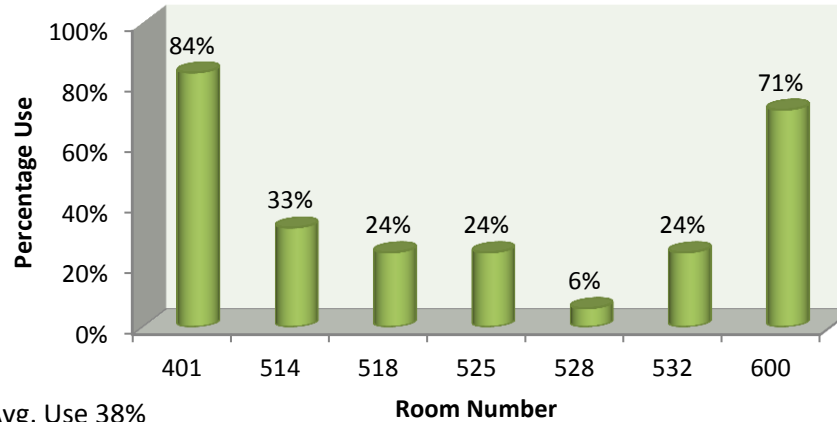


Avg. Use 38%

Hours scheduled outside the 08h00-18h00 window are not included (i.e. SDL, Part Time Studies, One-Off Bookings)

Rooms Not graphed – Field House: Use 12% Port 402, Lab 531, 535 : Use=0%

Data Source: EnCampus TPhi

Lab Rooms - Frost Main Campus

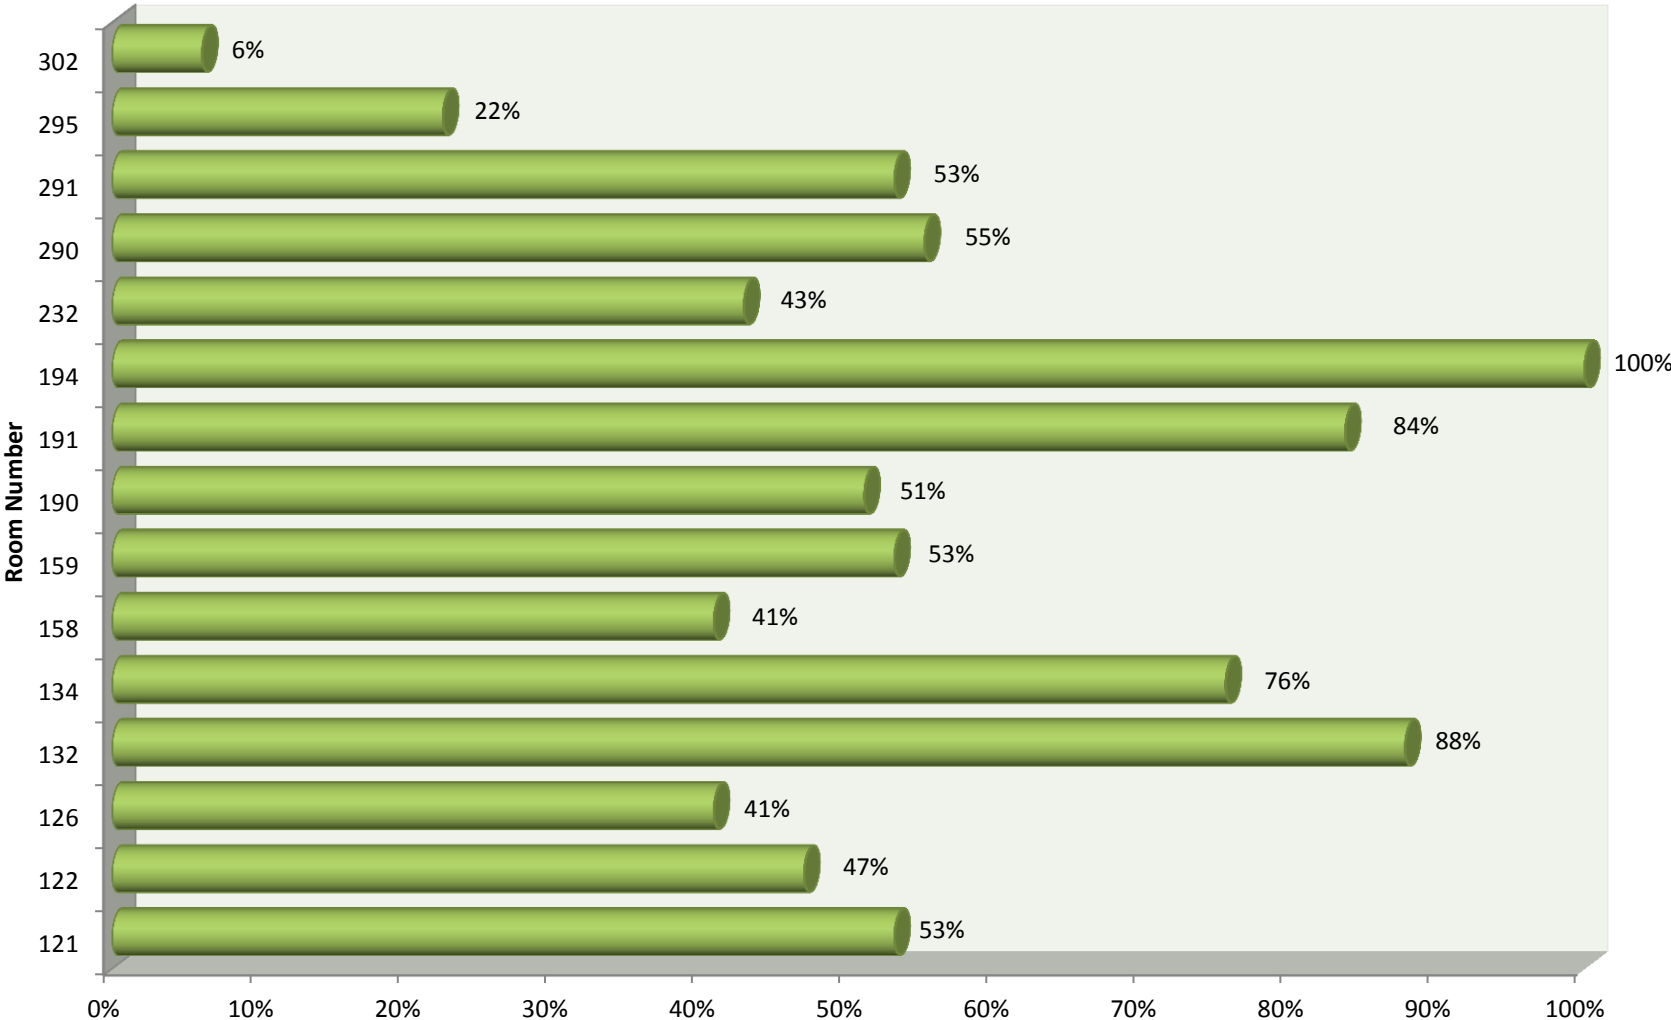


Avg Use=54.2%

Percentage Use

Room Utilization Charts – Winter 2013 Term

Frost Campus


Classrooms - Frost Outer Buildings

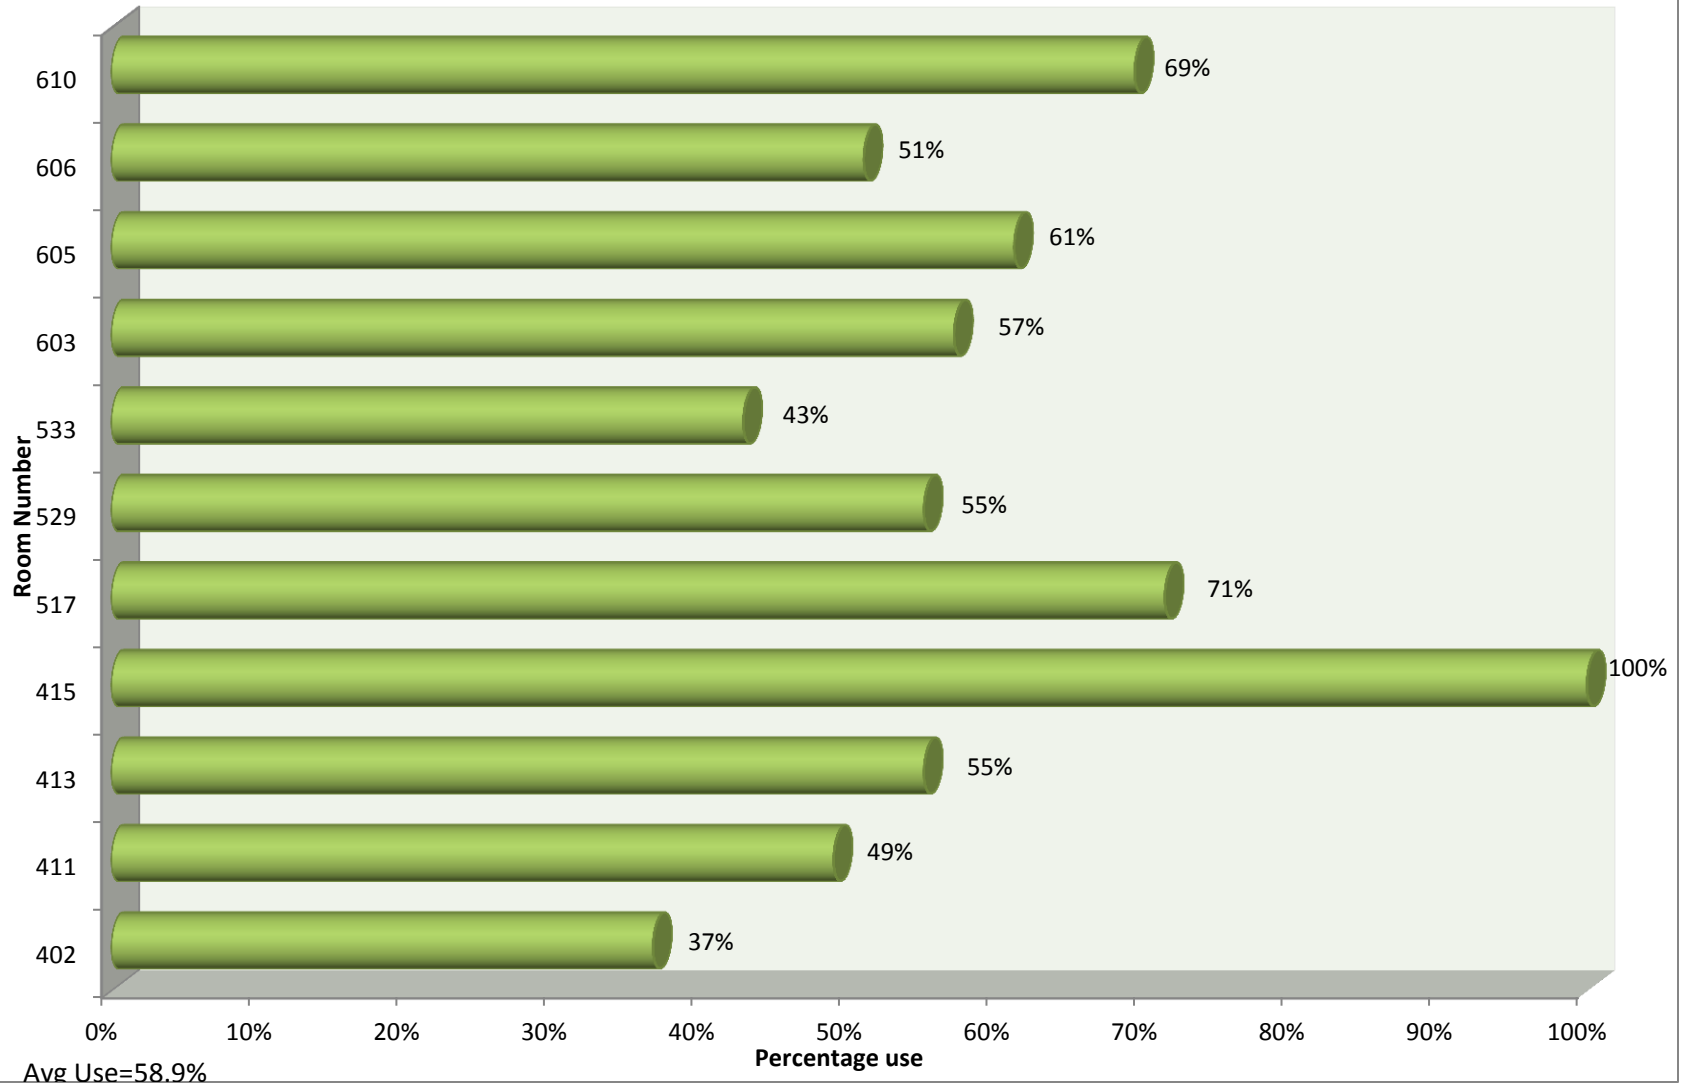

Room Utilization Charts – Winter 2013 Term

Frost Campus

Seminar Rooms - Frost Main Campus

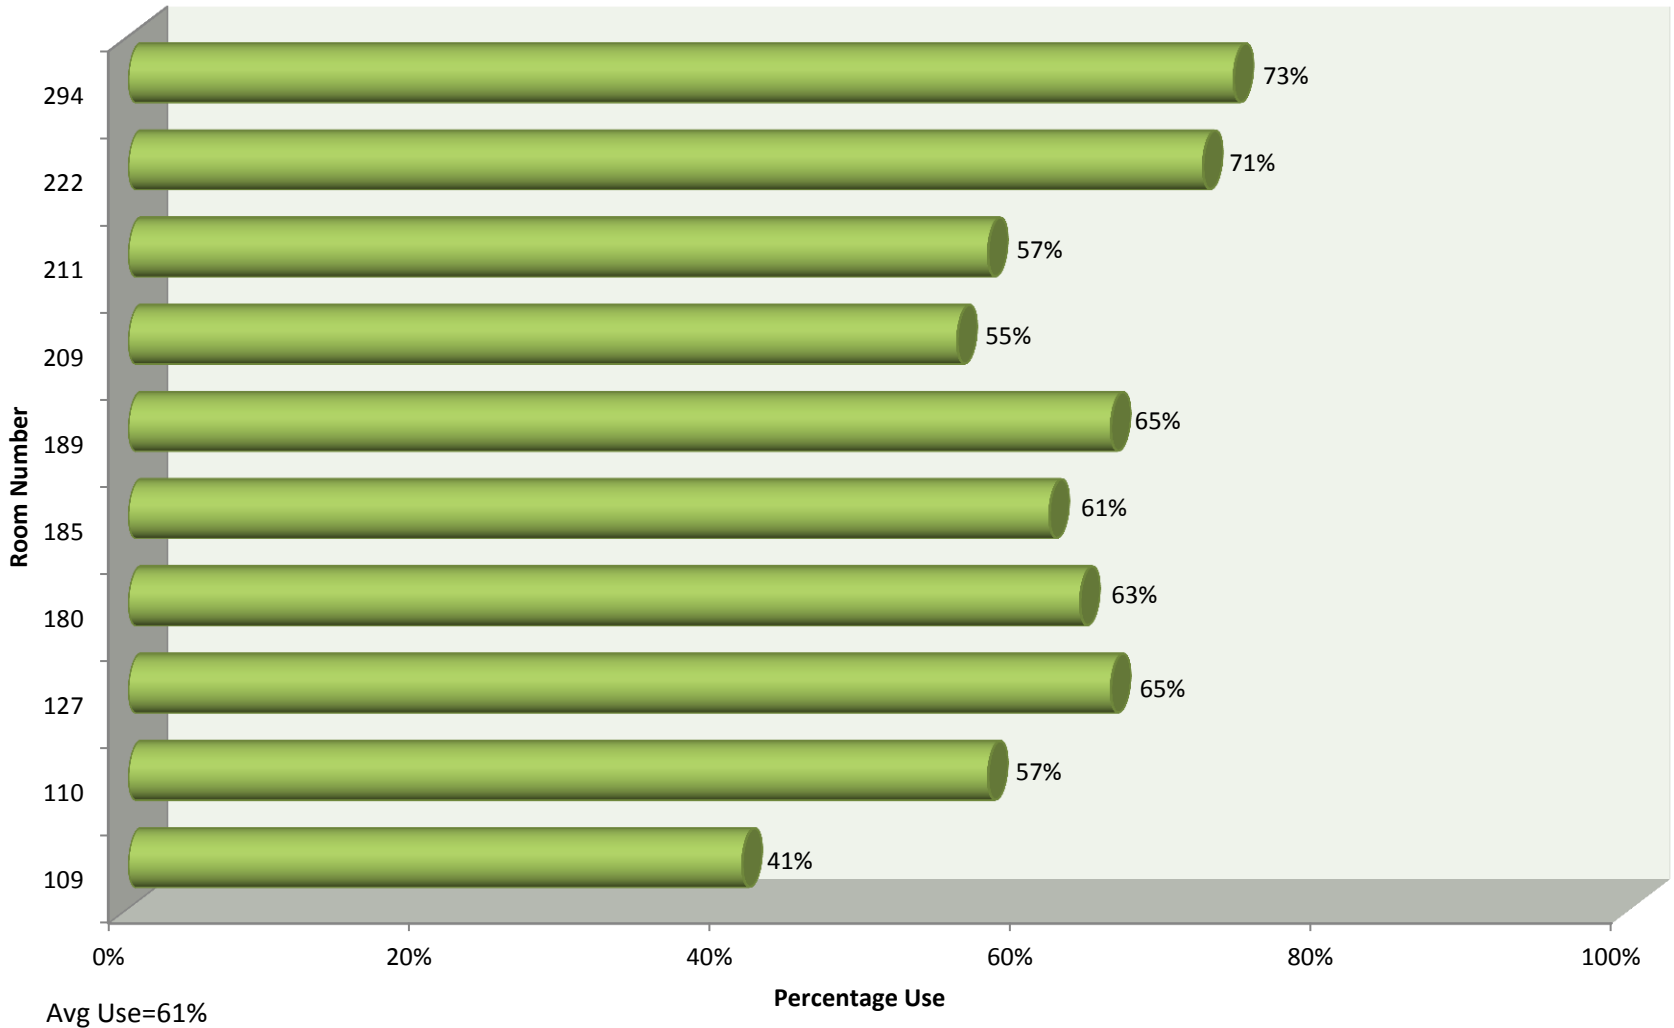

Hours scheduled outside the 08h00-18h00 window are not included (i.e. SDL, Part Time Studies, One-Off Bookings)


Rooms Not graphed – Field House:Use 12% Port 401, 402, Lab 531, 535 : Use=0%

Data Source:EnCampus TPHI

Room Utilization Charts Winter 2013 Term


Brealey Campus

Computer Labs - Brealey Campus

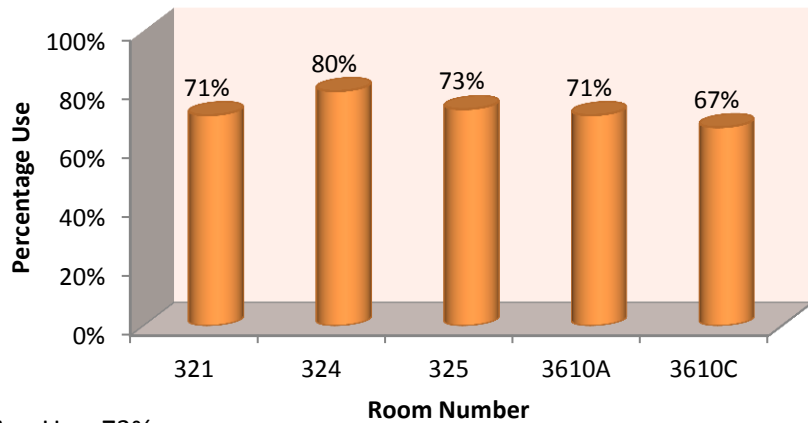


Avg Use=73%

Seminar Rooms - Brealey Campus

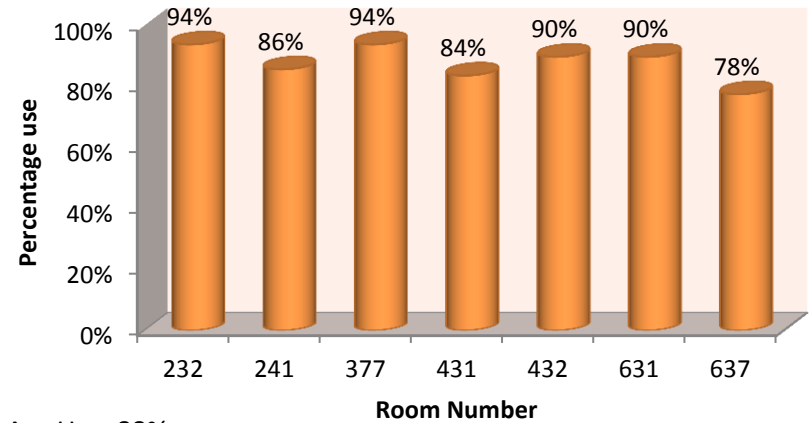


Avg Use=88%

Lecture Theatres - Brealey Campus

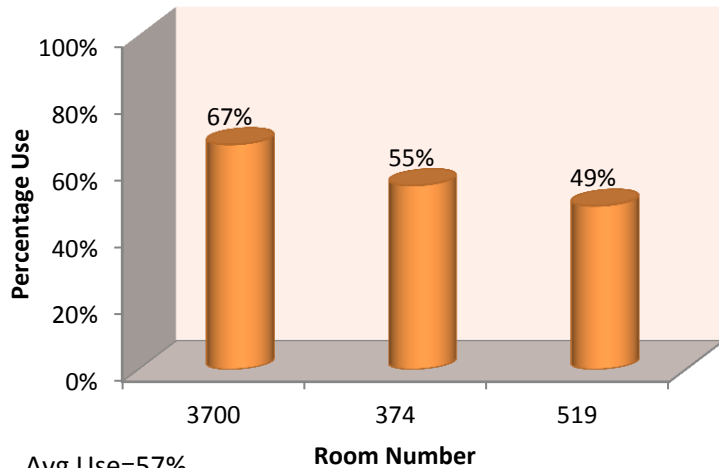

Avg Use=57%

Smart/E-Presentation Rooms - Brealey Campus

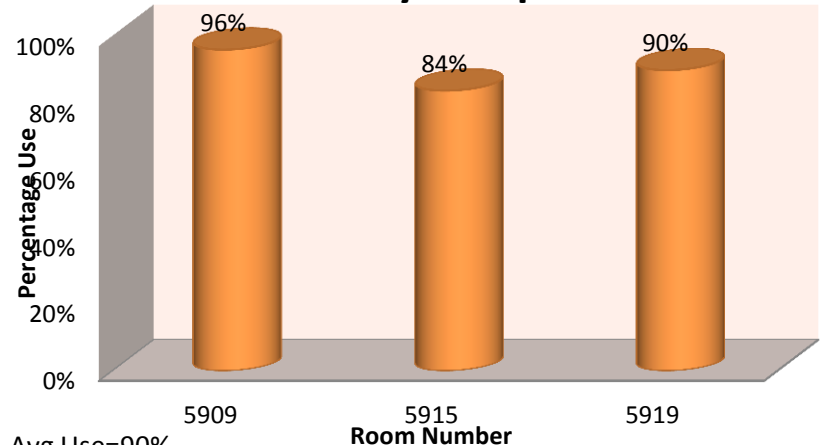

Avg Use=90%

Hours scheduled outside the 08h00-18h00 window are not included (i.e. SDL, Part Time Studies, One-Off Bookings)


Rooms Not graphed – Wellness Centre:Use 81%; BR632, 352B, 3605: Use=0%

Data Source:EnCampus TPHi

Room Utilization Charts – Winter 2013 Term

Brealey Campus

Classrooms - Brealey Campus

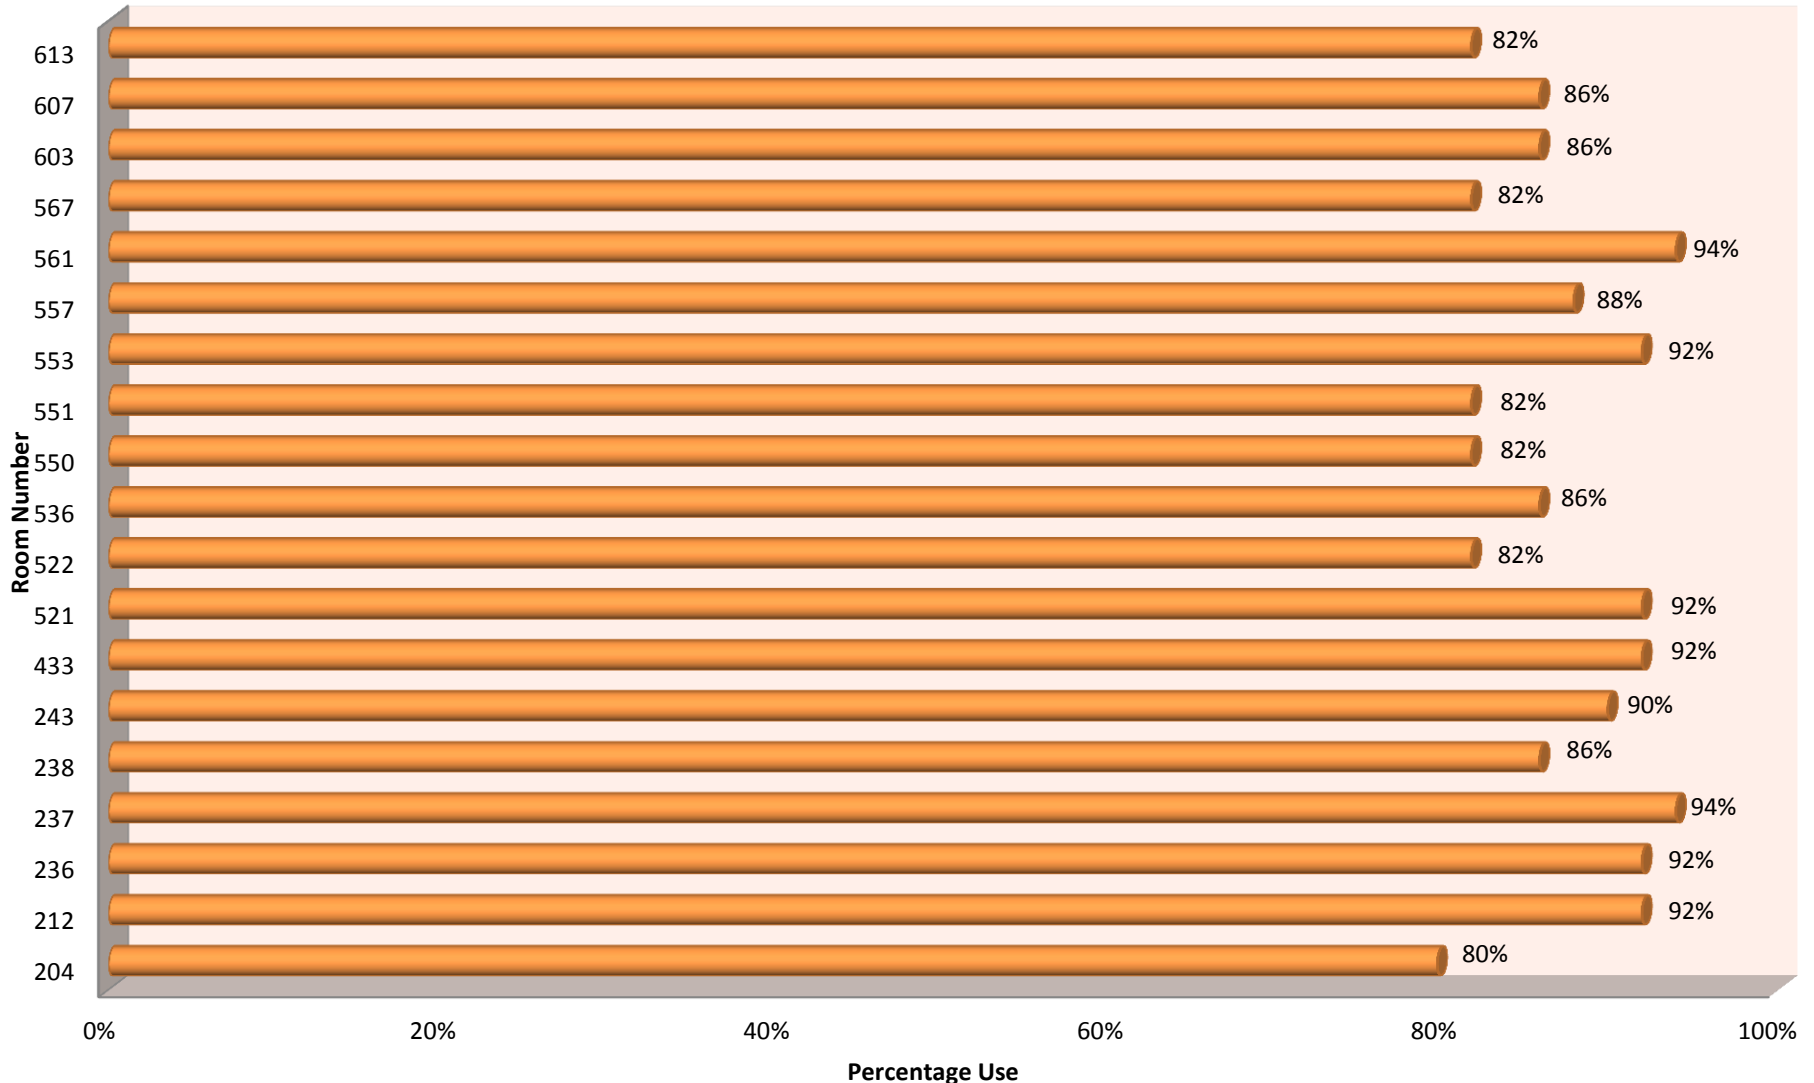


Hours scheduled outside the 08h00-18h00 window are not included (i.e. SDL, Part Time Studies, One-Off Bookings)

Rooms Not graphed – Wellness Centre:Use 81%; BR632, 352B, 3605: Use=0%

Data Source:EnCampus TPHi

Lab Rooms - Brealey Campus

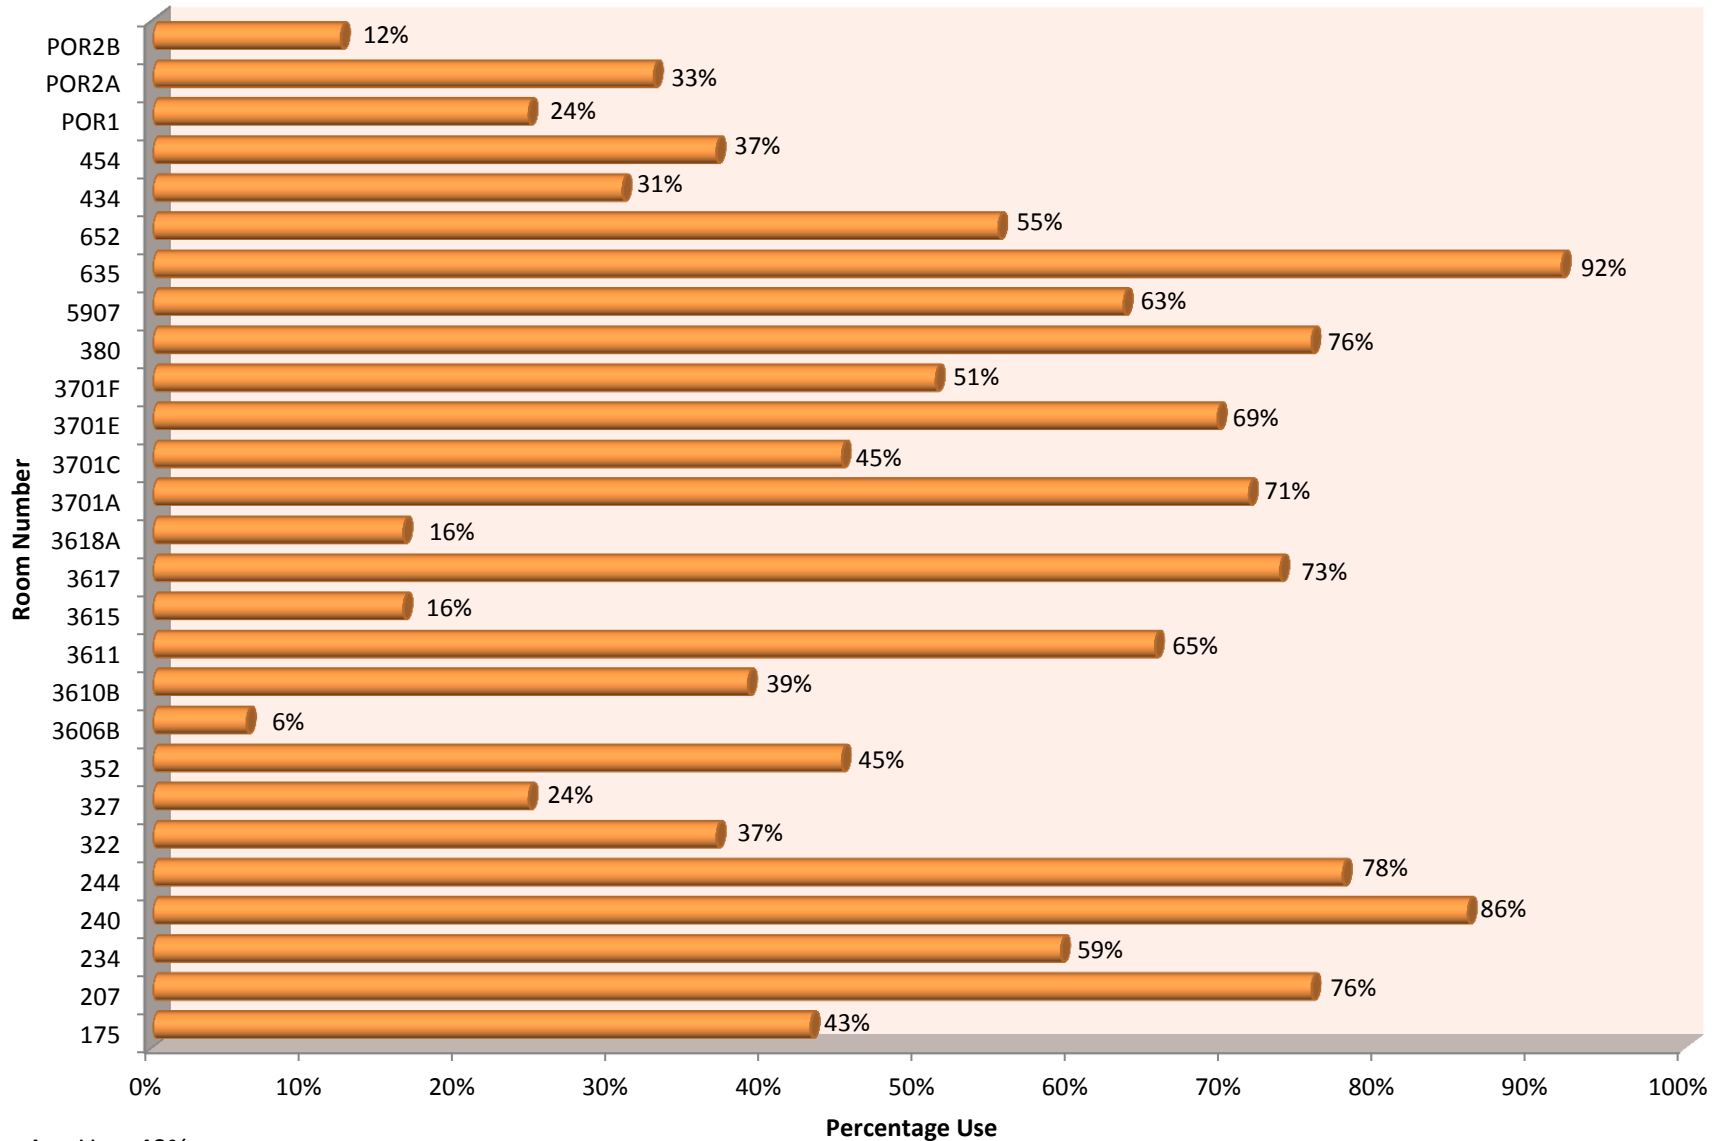

Hours scheduled outside the 08h00-18h00 window are not included (i.e. SDL, Part Time Studies, One-Off Bookings)

Rooms Not graphed – Wellness Centre:Use 81%; BR632, 352B, 3605: Use=0%

Data Source:EnCampus TPHI